

DORMAN
SMITH


MODIS 12

400A BUSBAR CT MOUNTING ARRANGEMENT MCCB

INSTALLATION INSTRUCTIONS


SHEET 1 OF 1

PANELS REMOVED FOR CLARITY

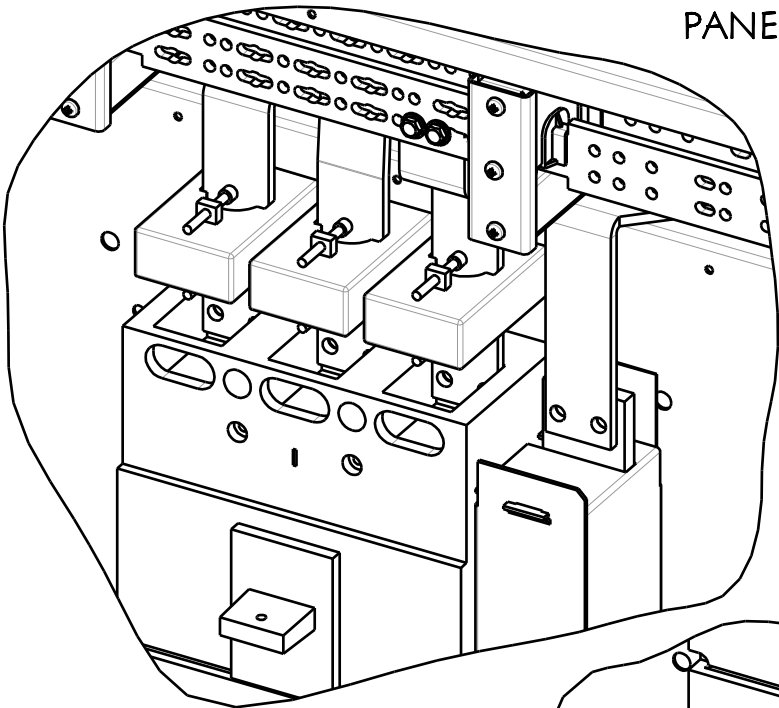

MCLM4BY
MCLM4TY:
CT'S MOUNTED IN THE
INCOMER ENCLOSURE

Y6

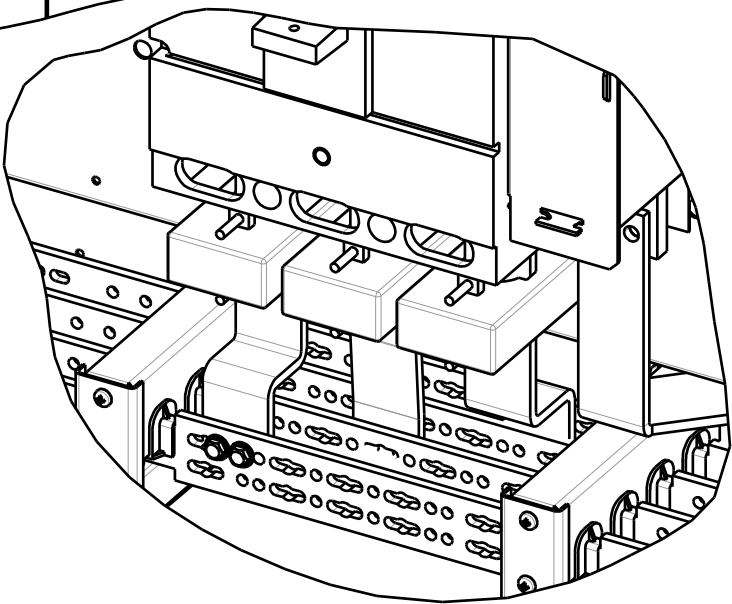

SN98323C

DRG

M216910

REV

0