

DORMAN  
SMITH

# MODIS 12

400A BUSBAR CT MOUNTING ARRANGEMENT FUSE SWITCH


INSTALLATION INSTRUCTIONS

SHEET 1 OF 1

PANELS REMOVED FOR CLARITY


MCLF4BA  
MCLF4TA:  
CT'S MOUNTED IN THE  
INCOMER ENCLOSURE

400A

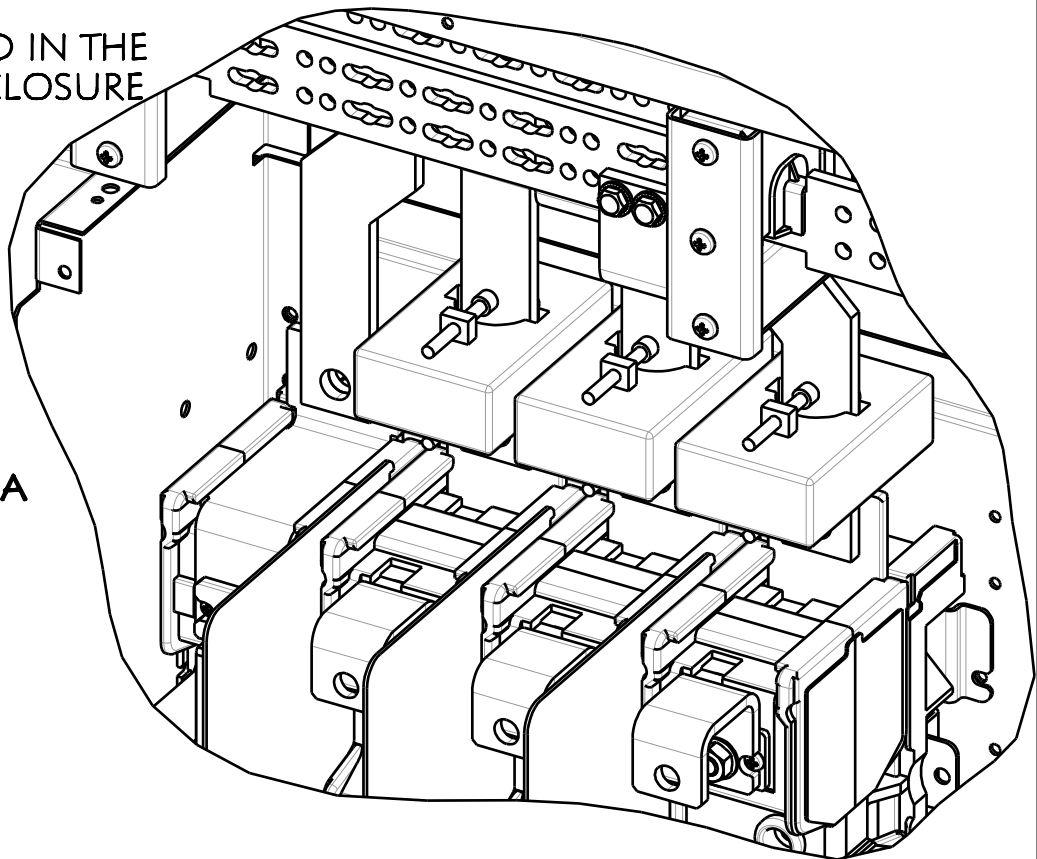

MCLF2A:  
CT'S MOUNTED IN BUSBAR CHAMBER  
AND INCOMER ENCLOSURE.

63-200A

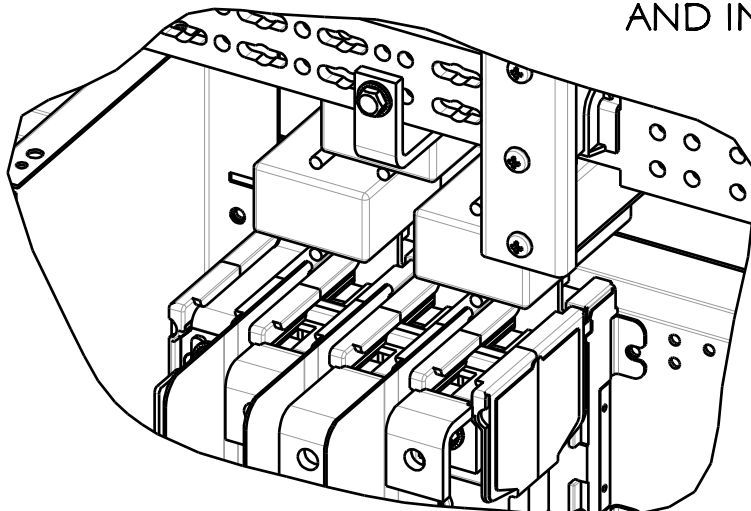

SN98325C

DRG

M216909

REV

0