


MODIS 12

1250A BUSBAR CT MOUNTING ARRANGEMENT FUSE SWITCH
INSTALLATION INSTUCTIONS


SHEET 1 OF 1

PANELS REMOVED FOR CLARITY

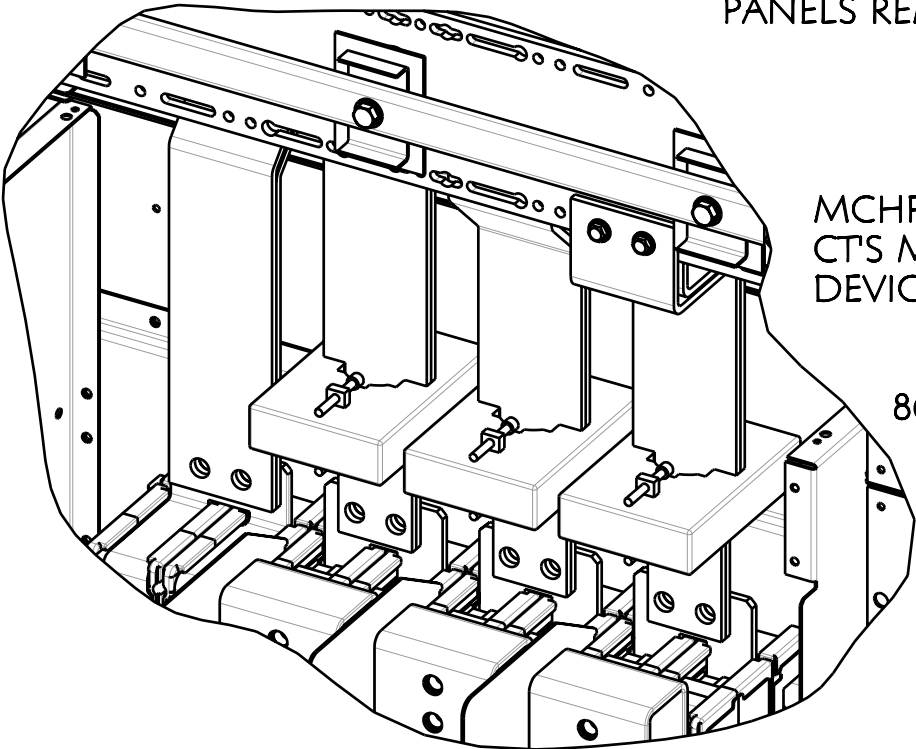


MCHF8A:
CT'S MOUNTED IN THE
DEVICE ENCLOSURE.

800A

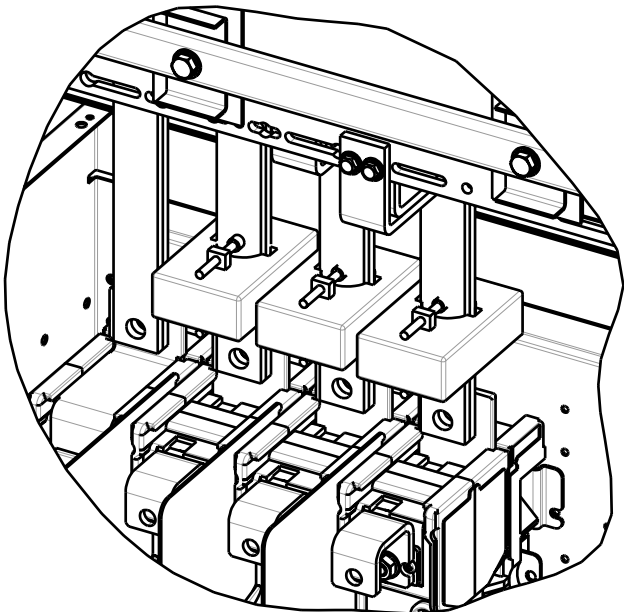

MCHF4A:
CT'S MOUNTED IN THE
DEVICE ENCLOSURE.

400A

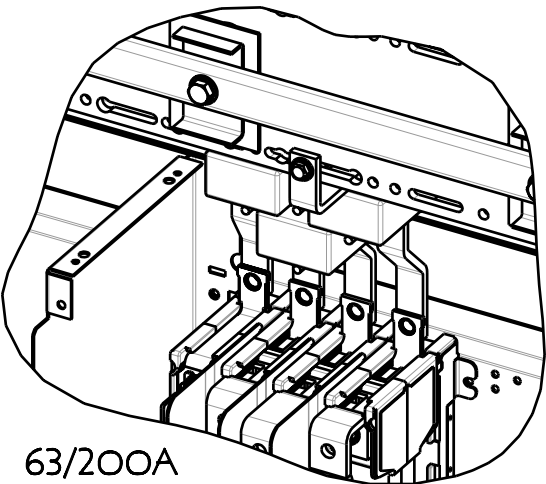

MCHF2A:
CT'S MOUNTED IN THE
BUSBAR CHAMBER.

63/200A

SN98324C