

DORMAN
SMITH


MODIS 12

1250A BUSBAR CT MOUNTING ARRANGEMENT MCCB

INSTALLATION INSTRUCTIONS


SHEET 1 OF 1

PANELS REMOVED FOR CLARITY

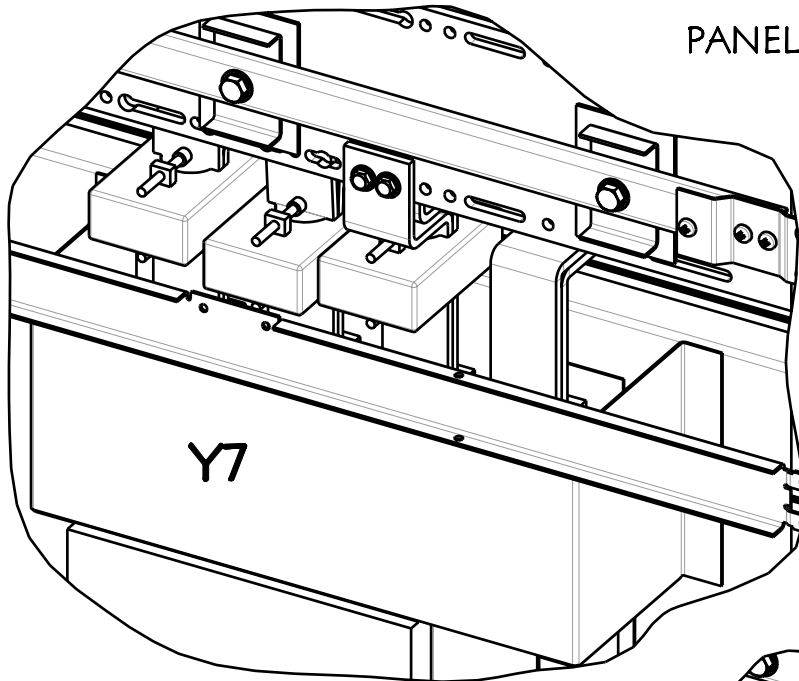


MCHM12Y:
CT'S MOUNTED IN THE
BUSBAR CHAMBER.

MCHM8Y
MCHM4Y:
CT'S MOUNTED IN THE
BUSBAR CHAMBER.

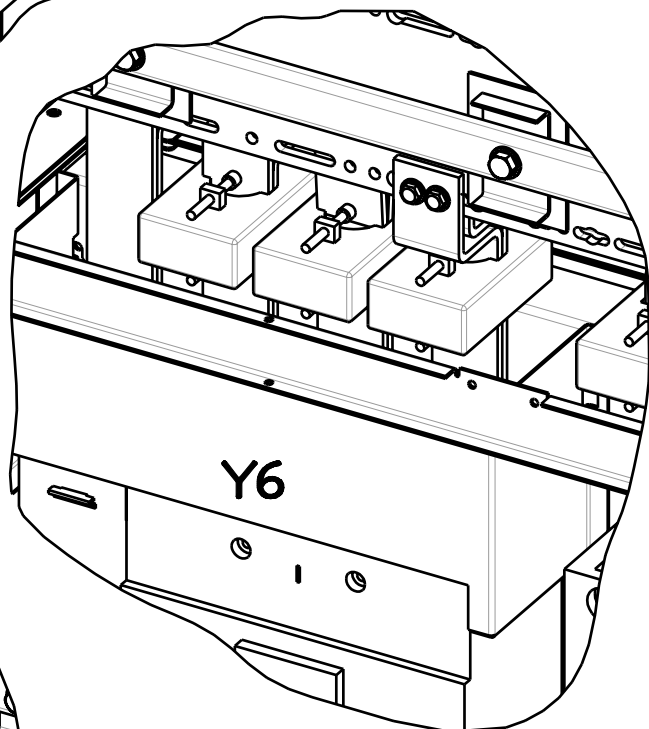

MCHMYA3:
CT'S MOUNTED UPSIDE DOWN
IN THE BUSBAR CHAMBER.

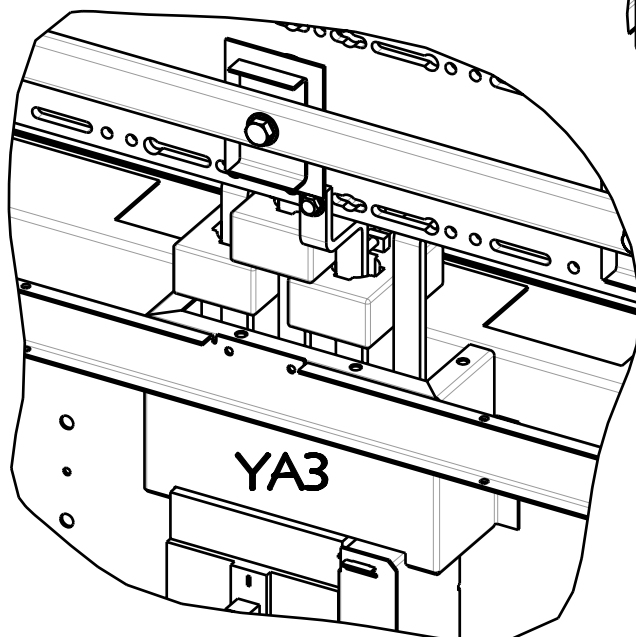

SN98322C

DRG

M216908

REV

0